

**TABLE OF CONTENTS**

- A. Construction Requirements
- B. Deflection and Haunching
- C. Rapid Set Concrete Patching Material – Vertical and Overhead Repairs

 <p>THIS SHEET HAS BEEN              SIGNED, SEALED AND DATED              ELECTRONICALLY.</p>	<p><b>MISSOURI HIGHWAYS AND                  TRANSPORTATION COMMISSION</b>                  105 W. CAPITOL AVE.                  JEFFERSON CITY, MO 65101                  Phone (888) 275-6636</p>
	<p><b>Wilson &amp; Company</b>                  800 East 101<sup>st</sup> Terrace, Suite 200                  Kansas City, MO 64131                  Certificate of Authority: 2003007599                  Consultant Phone: (816) 701-3100</p>
	<p>If a seal is present on this sheet, JSP's has                  been electronically sealed and dated.</p>
	<p>JOB NO. J1S3161                  Mercer County, MO                  Date Prepared: 6/25/2020</p>
	<p>Only the following items of the Job Special Provisions (Bridge) are authenticated by this                  seal: A - C</p>

JOB SPECIAL PROVISIONS (BRIDGE)

---

A. CONSTRUCTION REQUIREMENTS

**1.0 Description.** This provision contains general construction requirements for this project.

**2.0 Construction Requirements.** Plans for the existing structure(s) are included in the contract in the bridge electronic deliverables zip file for informational purposes only.

**2.1** In order to assure the least traffic interference, the work shall be scheduled so that the bridge closure is for the absolute minimum amount of time required to complete the work. The bridge shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed bridge is opened to traffic.

**2.2** Qualified special mortar shall be a qualified rapid set concrete patching material in accordance with [Sec 704](#). A qualified rapid set concrete patching material will not be permitted for half-sole repair, deck repair with void tube replacement, full depth repair, modified deck repair and substructure repair (formed) unless a note on the bridge plans specifies that a qualified special mortar may be used.

**2.3** The existing slab for the bridge(s) to be redecked was constructed as composite or non-composite as shown in the table below.

Bridge No.	Type of deck
N0855	Non-composite

**2.4** Provisions shall be made to prevent any debris and material from falling into the stream. If determined necessary by the engineer, any debris and material that falls below the bridge outside the previously specified limits shall be removed as approved by the engineer at the contractor's expense.

**2.5** Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

**2.6** Provisions shall be made to prevent damage to any existing utilities. Any damage sustained to the utilities as a result of the contractor's operations shall be the responsibility of the contractor. All costs of repair and disruption of service shall be as determined by the utility owners and as approved by the engineer.

**2.7** SSPC-SP2 and SSPC-SP3 surface preparation shall be in accordance with the environmental regulations in [Sec 1081](#) and collection of residue shall be in accordance with [Sec 1081](#) for collection of blast residue. SSPC-SP6, SSPC-SP10 and SSPC-SP11 surface preparation shall be in accordance with the approved blast media and environmental regulations in [Sec 1081](#) and collection of blast residue shall be in accordance with [Sec 1081](#).

**3.0 Method of Measurement.** No measurement will be made.

**4.0 Basis of Payment.** Payment for the above described work will be considered completely covered by the contract unit price for other items included in the contract.

B. DEFLECTION AND HAUNCHING

JOB SPECIAL PROVISIONS (BRIDGE)

---

**1.0 Description.** The contractor shall determine dead load deflections and haunching based on field measurements and/or existing bridge plans and these shall be adjusted based on the difference between the new and existing dead load weights.

**2.0 Construction Requirements.** In order to properly form the haunches for the new deck, the contractor shall survey top of deck elevations above each beam including centerline of roadway and along each beam line (top or bottom flange) prior to deck removal followed by surveying elevations of the beams (top or bottom flange) after deck removal.

**3.0 Method of Measurement.** No measurement will be made.

**4.0 Basis of Payment.** Payment for the above described work will be considered completely covered by the contract unit price for other items included in the contract.

**C. RAPID SET CONCRETE PATCHING MATERIAL – VERTICAL AND OVERHEAD REPAIRS**

**1.0 Description.** This specification covers cementitious concrete, polymer-modified concrete and polymer concrete that are suitable for repairing concrete surfaces on bridges or concrete structures, particularly under fast setting or special conditions. The repairs would involve vertical or overhead applications. The work shall consist of removing, furnishing, preparing, and placing materials at locations as shown on the plans or as directed by the engineer.

**2.0 Material.** All materials shall be in accordance with MoDOT specifications and as noted herein.

**2.1 Aggregate For Extending Commercial Mixture.** Coarse and fine aggregates shall be in accordance with [Sec 1005](#), except the requirements for gradation and percent passing the No. 200 sieve shall not apply. Coarse aggregate meeting Gradation E requirements shall be used for repairs greater than one inch (25 mm) in depth. Fine aggregate will be allowed for repairs less than one inch (25 mm). Aggregate specified, bagged, labeled and furnished by the rapid set concrete patching material manufacturer may also be used for mortar extension.

**2.2 Material Applications.** The contractor shall select and use the product most suitable for the work and field conditions in accordance with these specifications.

**2.3 Curing.** Rapid set concrete patching material shall be cured until the minimum compressive strength 1500 psi is attained using standard curing specifications, unless otherwise specified by the manufacturer.

**2.4 Qualification and Project Acceptance.**

**2.4.1 Inspection.** All materials shall be subject to inspection and sampling by MoDOT at the source of manufacture, intermediate shipping terminal or destination. MoDOT will be allowed free access to all facilities and records as required to conduct inspection and sampling.

**2.4.2 Qualification.** Prior to use, rapid set concrete patching materials need to be qualified.

**2.4.2.1 Requested Information.** The manufacturer shall submit with samples of the materials, a written request to Construction and Materials with the following information:

- (a) New Products Evaluation Form

- (b) Brand name of the product.
- (c) Certification that the material meets this specification.
- (d) Certified test results from an independent laboratory showing compliance with this specification.
- (e) Specific preparation instructions of repair area.
- (f) Specific mixing, handling and curing instructions.
- (g) Application type (i.e., vertical or overhead).

**2.4.2.2 Field Evaluation.** Final approval will be granted when the following requirements are met:

- (a) MoDOT report documenting two years of field performance on MoDOT system. The report will contain the placement date, field observations (semi annual), description of field performance and photographs of in-place material.
- (b) A manufacturer's representative shall be present during placement of the material to provide technical expertise.

**2.4.2.2.3 Disqualification.** If during the two year observation period the repair area(s) fails the product will not be added to the qualified list.

**2.5 Qualified List.** The listing of qualified products are available from Construction and Materials or on MoDOT's web site. New certified test results and samples shall be submitted any time the manufacturing process or the material formulation is changed. The material will be subject to removal from the qualified list if there is evidence of unsatisfactory performance or a change in manufacturing process or formulation, or when random sampling and testing of material offered for use indicates nonconformity with any of the requirements herein specified.

**2.6 Certification.** The contractor shall supply a manufacturer's certification to the engineer for each lot of material furnished. The certification shall include the name of the manufacturer, a manufacturer certification statement that the material supplied is the same as that qualified and listing the date of qualification.

**2.7 Acceptance.** Acceptance of the material will be based on the use of a qualified product, the manufacturer's certification that the material supplied is the same as that approved and upon the results of such tests as may be performed by the engineer.

**3.0 Mixture.** Unless otherwise specified, rapid set concrete patching material shall be approved commercial mixtures meeting [Sections 3.1 – 3.1.3](#). Rapid set concrete patching materials shall be specifically designed for the application needed.

**3.1 Commercial Mixtures.** Rapid set concrete patching material in its sacked form and mixtures when properly prepared in accordance with the manufacturer's specifications, shall meet the minimum test requirements given in Table 1. Mixtures may be supplied, as required, as a patching mortar or as a patching mortar with aggregate extension. If the material is to be

JOB SPECIAL PROVISIONS (BRIDGE)

supplied with extender aggregate, this shall also pass the required tests in Table 1 using the maximum allowed amount of extender aggregate.

**3.1.1 Mixture Requirements.** Rapid set concrete patching material shall be single packaged dry mix requiring the addition of water or other liquid component just prior to mixing. The material shall not contain soluble chlorides as an ingredient of manufacture. The material shall be placed in accordance to the manufacturer's recommendations.

<b>Table 1 (English Unit)</b>				
<b>Physical Test Property</b>	<b>Specification</b>	<b>Requirement for cementitious concrete</b>	<b>Requirement for polymer-modified concrete</b>	<b>Requirement for polymer concrete</b>
Bond Strength by Slant Shear	ASTM C882/C928 <sup>2</sup>	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days	n/a	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days
Linear Coefficient of Thermal Expansion <sup>1</sup> (for bagged mortar only, without extension aggregate)	ASTM C531	n/a	n/a	4 – 8 X 10-6 in/in/deg F
Resistance to Rapid Freezing & Thawing	AASHTO T161 or ASTM C666	80% min. using Procedure B <sup>3</sup> (300 Cycles)	80% min. using Procedure B <sup>3</sup> (300 Cycles)	n/a
Compressive Strength	AASHTO T22 or ASTM C39	1500 psi @ 3 hr & 3000 psi @ 24 hr	1500 psi @ 3 hr & 3000 psi @ 24 hr	n/a
Rapid Chloride Permeability	AASHTO T277 or ASTM C1202	1000 coulombs @ 28 days	1000 coulombs @ 28 days	1000 coulombs @ 28 days
Length Change	AASHTO T 160 or ASTM C157	In water Storage (+0.15) In air storage (-0.15)	In water storage (+0.15) In air storage (-0.15)	n/a
Color		gray	gray	gray

<sup>1</sup> Not required for extended mixtures if the mortar passes this requirement.

<sup>2</sup> ASTM C882 shall be performed on non-water based materials. ASTM C928 shall be performed on water-based materials.

<sup>3</sup> Procedure A may be used in lieu of Procedure B

**3.1.2 Construction Requirements.** The manufacturer shall provide with the bagged mixture, specifications for the mixing procedure, amount and kind of liquid to be added, and the amount of aggregate extension allowed, if any. All mixing, handling and curing practices recommended by the manufacturer shall be followed and will be considered a part of these specifications.

**3.1.3 Removal from Qualified List.** All mixtures shall be approved before use. Reoccurring failures of any mixture for any reason will be cause for removal from the qualified list.

JOB SPECIAL PROVISIONS (BRIDGE)

---

**3.2 Vertical Repair..** A qualified rapid set concrete patching material approved for vertical use may be used when specified on the plans and as approved by the engineer. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength. The material shall adhere to the concrete surface without sagging.

**3.3 Overhead Repair.** A qualified rapid set concrete patching material approved for overhead use may be used when specified on the plans and as approved by the engineer. The material shall be placeable in layers of at least 1 inch on overhead applications without the use of formwork or anchoring devices. The material shall adhere to the concrete surface without sagging. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength.

**4.0 Construction Requirements.**

**4.1 Mixing.** Rapid set concrete patching material shall be mixed and finished according to the manufacturer's recommendation.

**4.2 Preparation of Repair Area.** Deteriorated, damaged or defective concrete as shown on the plans, required by the specifications or as directed by the engineer, shall be removed. All exposed reinforcement shall be thoroughly cleaned as shown on the plans, required by the specifications or as directed by the engineer. Unless otherwise specified by the commercial mixture manufacturer, the existing surface shall be damp and all free water shall be removed prior to placement of the required material.

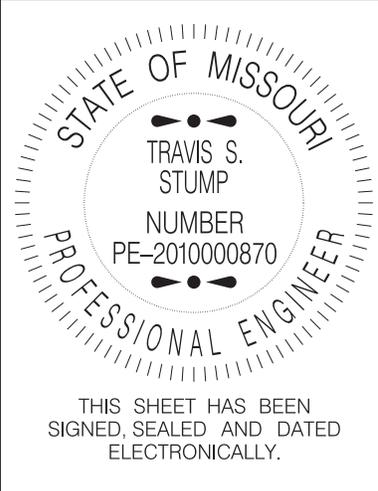
**4.3 Bonding Agent.** A bonding agent may be used if recommended by the rapid set concrete patching material manufacturer.

**5.0 Method of Measurement.** No measurement will be made for rapid set concrete patching material.

**6.0 Basis of Payment.** Rapid set concrete patching material will be paid for at the contract unit price for other items and will be considered full compensation for all labor, equipment and material to complete the described work.

**TABLE OF CONTENTS**

- A. Construction Requirements
- B. Rapid Set Concrete Patching Material – Vertical and Overhead Repairs
- C. Deflection and Haunching

 <p>THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY.</p>	<p><b>MISSOURI HIGHWAYS AND TRANSPORTATION COMMISSION</b> 105 W. CAPITOL AVE. JEFFERSON CITY, MO 65101 Phone (888) 275-6636</p>
	<p>If a seal is present on this sheet, JSP's has been electronically sealed and dated.</p>
	<p>JOB NO. J1S3163 Putnam County, MO Date Prepared: 8/3/2020</p>

Only the following items of the Job Special Provisions (Bridge) are authenticated by this seal: A - C

JOB SPECIAL PROVISIONS (BRIDGE)

---

A. CONSTRUCTION REQUIREMENTS

**1.0 Description.** This provision contains general construction requirements for this project.

**2.0 Construction Requirements.** Plans for the existing structure(s) and the asbestos and lead report for the structure(s) are included in the contract in the bridge electronic deliverables zip file for informational purposes only.

**2.1** In order to assure the least traffic interference, the work shall be scheduled so that the bridge closure is for the absolute minimum amount of time required to complete the work. The bridge shall not be closed until material is available for continuous construction and the contractor is prepared to diligently pursue the work until the closed bridge is opened to traffic.

**2.2** Qualified special mortar shall be a qualified rapid set concrete patching material in accordance with [Sec 704](#). A qualified rapid set concrete patching material will not be permitted for half-sole repair, deck repair with void tube replacement, full depth repair, modified deck repair and substructure repair (formed) unless a note on the bridge plans specifies that a qualified special mortar may be used.

**2.3** The existing slab for the bridge(s) to be redecked was constructed as composite or non-composite as shown in the table below.

Bridge No.	Type of deck
P0834	Non-composite

**2.4** Provisions shall be made to prevent any debris and material from falling into the stream. If determined necessary by the engineer, any debris and material that falls below the bridge outside the previously specified limits shall be removed as approved by the engineer at the contractor's expense.

**2.5** Any damage sustained to the remaining structure as a result of the contractor's operations shall be repaired or the material replaced as approved by the engineer at the contractor's expense.

**2.6** Provisions shall be made to prevent damage to any existing utilities. Any damage sustained to the utilities as a result of the contractor's operations shall be the responsibility of the contractor. All costs of repair and disruption of service shall be as determined by the utility owners and as approved by the engineer.

**2.7** SSPC-SP2 and SSPC-SP3 surface preparation shall be in accordance with the environmental regulations in [Sec 1081](#) and collection of residue shall be in accordance with [Sec 1081](#) for collection of blast residue. SSPC-SP6, SSPC-SP10 and SSPC-SP11 surface preparation shall be in accordance with the approved blast media and environmental regulations in [Sec 1081](#) and collection of blast residue shall be in accordance with [Sec 1081](#).

**3.0 Method of Measurement.** No measurement will be made.

**4.0 Basis of Payment.** Payment for the above described work will be considered completely covered by the contract unit price for other items included in the contract.

JOB SPECIAL PROVISIONS (BRIDGE)

---

B. RAPID SET CONCRETE PATCHING MATERIAL – VERTICAL AND OVERHEAD REPAIRS

**1.0 Description.** This specification covers cementitious concrete, polymer-modified concrete and polymer concrete that are suitable for repairing concrete surfaces on bridges or concrete structures, particularly under fast setting or special conditions. The repairs would involve vertical or overhead applications. The work shall consist of removing, furnishing, preparing, and placing materials at locations as shown on the plans or as directed by the engineer.

**2.0 Material.** All materials shall be in accordance with MoDOT specifications and as noted herein.

**2.1 Aggregate. For Extending Commercial Mixture.** Coarse and fine aggregates shall be in accordance with [Sec 1005](#), except the requirements for gradation and percent passing the No. 200 sieve shall not apply. Coarse aggregate meeting Gradation E requirements shall be used for repairs greater than one inch (25 mm) in depth. Fine aggregate will be allowed for repairs less than one inch (25 mm). Aggregate specified, bagged, labeled and furnished by the rapid set concrete patching material manufacturer may also be used for mortar extension.

**2.2 Material Applications.** The contractor shall select and use the product most suitable for the work and field conditions in accordance with these specifications.

**2.3 Curing.** Rapid set concrete patching material shall be cured until the minimum compressive strength 1500 psi is attained using standard curing specifications, unless otherwise specified by the manufacturer.

**2.4 Qualification and Project Acceptance.**

**2.4.1 Inspection.** All materials shall be subject to inspection and sampling by MoDOT at the source of manufacture, intermediate shipping terminal or destination. MoDOT will be allowed free access to all facilities and records as required to conduct inspection and sampling.

**2.4.2 Qualification.** Prior to use, rapid set concrete patching materials need to be qualified.

**2.4.2.1 Requested Information.** The manufacturer shall submit with samples of the materials, a written request to Construction and Materials with the following information:

- (a) New Products Evaluation Form
- (b) Brand name of the product.
- (c) Certification that the material meets this specification.
- (d) Certified test results from an independent laboratory showing compliance with this specification.
- (e) Specific preparation instructions of repair area.
- (f) Specific mixing, handling and curing instructions.
- (g) Application type (i.e., vertical or overhead).

JOB SPECIAL PROVISIONS (BRIDGE)

---

**2.4.2.2 Field Evaluation.** Final approval will be granted when the following requirements are met:

- (a) MoDOT report documenting two years of field performance on MoDOT system. The report will contain the placement date, field observations (semi annual), description of field performance and photographs of in-place material.
- (b) A manufacturer's representative shall be present during placement of the material to provide technical expertise.

**2.4.2.2.3 Disqualification.** If during the two year observation period the repair area(s) fails the product will not be added to the qualified list.

**2.5 Qualified List.** The listing of qualified products are available from Construction and Materials or on MoDOT's web site. New certified test results and samples shall be submitted any time the manufacturing process or the material formulation is changed. The material will be subject to removal from the qualified list if there is evidence of unsatisfactory performance or a change in manufacturing process or formulation, or when random sampling and testing of material offered for use indicates nonconformity with any of the requirements herein specified.

**2.6 Certification.** The contractor shall supply a manufacturer's certification to the engineer for each lot of material furnished. The certification shall include the name of the manufacturer, a manufacturer certification statement that the material supplied is the same as that qualified and listing the date of qualification.

**2.7 Acceptance.** Acceptance of the material will be based on the use of a qualified product, the manufacturer's certification that the material supplied is the same as that approved and upon the results of such tests as may be performed by the engineer.

**3.0 Mixture.** Unless otherwise specified, rapid set concrete patching material shall be approved commercial mixtures meeting [Sections 3.1 – 3.1.3.](#) Rapid set concrete patching materials shall be specifically designed for the application needed.

**3.1 Commercial Mixtures.** Rapid set concrete patching material in its sacked form and mixtures when properly prepared in accordance with the manufacturer's specifications, shall meet the minimum test requirements given in Table 1. Mixtures may be supplied, as required, as a patching mortar or as a patching mortar with aggregate extension. If the material is to be supplied with extender aggregate, this shall also pass the required tests in Table 1 using the maximum allowed amount of extender aggregate.

**3.1.1 Mixture Requirements.** Rapid set concrete patching material shall be single packaged dry mix requiring the addition of water or other liquid component just prior to mixing. The material shall not contain soluble chlorides as an ingredient of manufacture. The material shall be placed in accordance to the manufacturer's recommendations.

JOB SPECIAL PROVISIONS (BRIDGE)

<b>Table 1 (English Unit)</b>				
<b>Physical Test Property</b>	<b>Specification</b>	<b>Requirement for cementitious concrete</b>	<b>Requirement for polymer-modified concrete</b>	<b>Requirement for polymer concrete</b>
Bond Strength by Slant Shear	ASTM C882/C928 <sup>2</sup>	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days	n/a	min. 1000 psi @ 24hrs. & min. 1500 psi @ 7 days
Linear Coefficient of Thermal Expansion <sup>1</sup> (for bagged mortar only, without extension aggregate)	ASTM C531	n/a	n/a	4 – 8 X 10 <sup>-6</sup> in/in/deg F
Resistance to Rapid Freezing & Thawing	AASHTO T161 or ASTM C666	80% min. using Procedure B <sup>3</sup> (300 Cycles)	80% min. using Procedure B <sup>3</sup> (300 Cycles)	n/a
Compressive Strength	AASHTO T22 or ASTM C39	1500 psi @ 3 hr & 3000 psi @ 24 hr	1500 psi @ 3 hr & 3000 psi @ 24 hr	n/a
Rapid Chloride Permeability	AASHTO T277 or ASTM C1202	1000 coulombs @ 28 days	1000 coulombs @ 28 days	1000 coulombs @ 28 days
Length Change	AASHTO T 160 or ASTM C157	In water Storage (+0.15) In air storage (-0.15)	In water storage (+0.15) In air storage (-0.15)	n/a
Color		gray	gray	gray

<sup>1</sup> Not required for extended mixtures if the mortar passes this requirement.

<sup>2</sup> ASTM C882 shall be performed on non-water based materials. ASTM C928 shall be performed on water-based materials.

<sup>3</sup> Procedure A may be used in lieu of Procedure B

**3.1.2 Construction Requirements.** The manufacturer shall provide with the bagged mixture, specifications for the mixing procedure, amount and kind of liquid to be added, and the amount of aggregate extension allowed, if any. All mixing, handling and curing practices recommended by the manufacturer shall be followed and will be considered a part of these specifications.

**3.1.3 Removal from Qualified List.** All mixtures shall be approved before use. Reoccurring failures of any mixture for any reason will be cause for removal from the qualified list.

**3.2 Vertical Repair.** A qualified rapid set concrete patching material approved for vertical use may be used when specified on the plans and as approved by the engineer. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength. The material shall adhere to the concrete surface without sagging.

**3.3 Overhead Repair.** A qualified rapid set concrete patching material approved for overhead use may be used when specified on the plans and as approved by the engineer. The material

JOB SPECIAL PROVISIONS (BRIDGE)

---

shall be placeable in layers of at least 1 inch on overhead applications without the use of formwork or anchoring devices. The material shall adhere to the concrete surface without sagging. The engineer will make field cylinders to verify the 1500 psi (10 MPa) minimum strength.

**4.0 Construction Requirements.**

**4.1 Mixing.** Rapid set concrete patching material shall be mixed and finished according to the manufacturer's recommendation.

**4.2 Preparation of Repair Area.** Deteriorated, damaged or defective concrete as shown on the plans, required by the specifications or as directed by the engineer, shall be removed. All exposed reinforcement shall be thoroughly cleaned as shown on the plans, required by the specifications or as directed by the engineer. Unless otherwise specified by the commercial mixture manufacturer, the existing surface shall be damp and all free water shall be removed prior to placement of the required material.

**4.3 Bonding Agent.** A bonding agent may be used if recommended by the rapid set concrete patching material manufacturer.

**5.0 Method of Measurement.** No measurement will be made for rapid set concrete patching material.

**6.0 Basis of Payment.** Rapid set concrete patching material will be paid for at the contract unit price for other items and will be considered full compensation for all labor, equipment and material to complete the described work.

C. DEFLECTION AND HAUNCHING

**1.0 Description.** The contractor shall determine dead load deflections and haunching based on field measurements and/or existing bridge plans and these shall be adjusted based on the difference between the new and existing dead load weights.

**2.0 Construction Requirements.** In order to properly form the haunches for the new deck, the contractor shall survey top of deck elevations above each beam including centerline of roadway and along each beam line (top or bottom flange) prior to deck removal followed by surveying elevations of the beams (top or bottom flange) after deck removal.

**3.0 Method of Measurement.** No measurement will be made.

**4.0 Basis of Payment.** Payment for the above described work will be considered completely covered by the contract unit price for other items included in the contract.